


THIS DRAWING IS TO BE USED AS A GUIDE ONLY. PIE&G SHALL NOT BE RESPONSIBLE FOR ANY DAMAGES FROM ANY USE OR MISUSE OF THIS SPECIFICATION.

NOTES:

- A) ALL MEMBER'S SEVICE EQUIPMENT IS PER THE NATIONAL ELECTRIC CODE (NEC) AND MUST BE APPROVED BY THE LOCAL ELECTRICAL INSPECTOR. PIE&G **CAN NOT** ENERGIZE THE SERVICE WITHOUT THIS APPROVAL.
- B) ALL SERVICE WIRING AND EQUIPMENT TO BE FURNISHED AND INSTALLED BY THE MEMBER.
- C) PIE&G RESERVES THE RIGHT TO REFUSE TO ENERGIZE ANY SERVICE THAT IN OUR OPINION IS UNSAFE OR DOES NOT MEET SPECIFICATIONS.

- ① PIE&G SERVICE DROP - MIN 12' GROUND CLEARANCE
- ② MEMBERS' SERVICE ENTRANCE CONDUCTORS WITH MIN. 2' TAILS AS REQUIRED
- ③ WEATHERHEAD - RAIN TIGHT, MUST BE 30" MIN. AND 48" MAX. FROM ROOF LINE IF ADDITIONAL HEIGHT IS NEEDED TO MAINTAIN NATIONAL ELECTRIC CODE (NEC) CLEARANCE THEN PROPER MAST GUYING OR BRACING IS REQUIRED.
- ④ CONDUIT SERVICE MAST AS REQUIRED
- ⑤ CONDUIT CLAMPS AS REQUIRED
- ⑥ CONNECTORS AS REQUIRED
- ⑦ MEMBER'S METER BASE - 4' MIN., 6' MAX.
- ⑧ MEMBER'S SERVICE PANEL AND SERVICE ENTRANCE EQUIPMENT AS REQUIRED
- ⑨ GROUNDING AS PER NEC

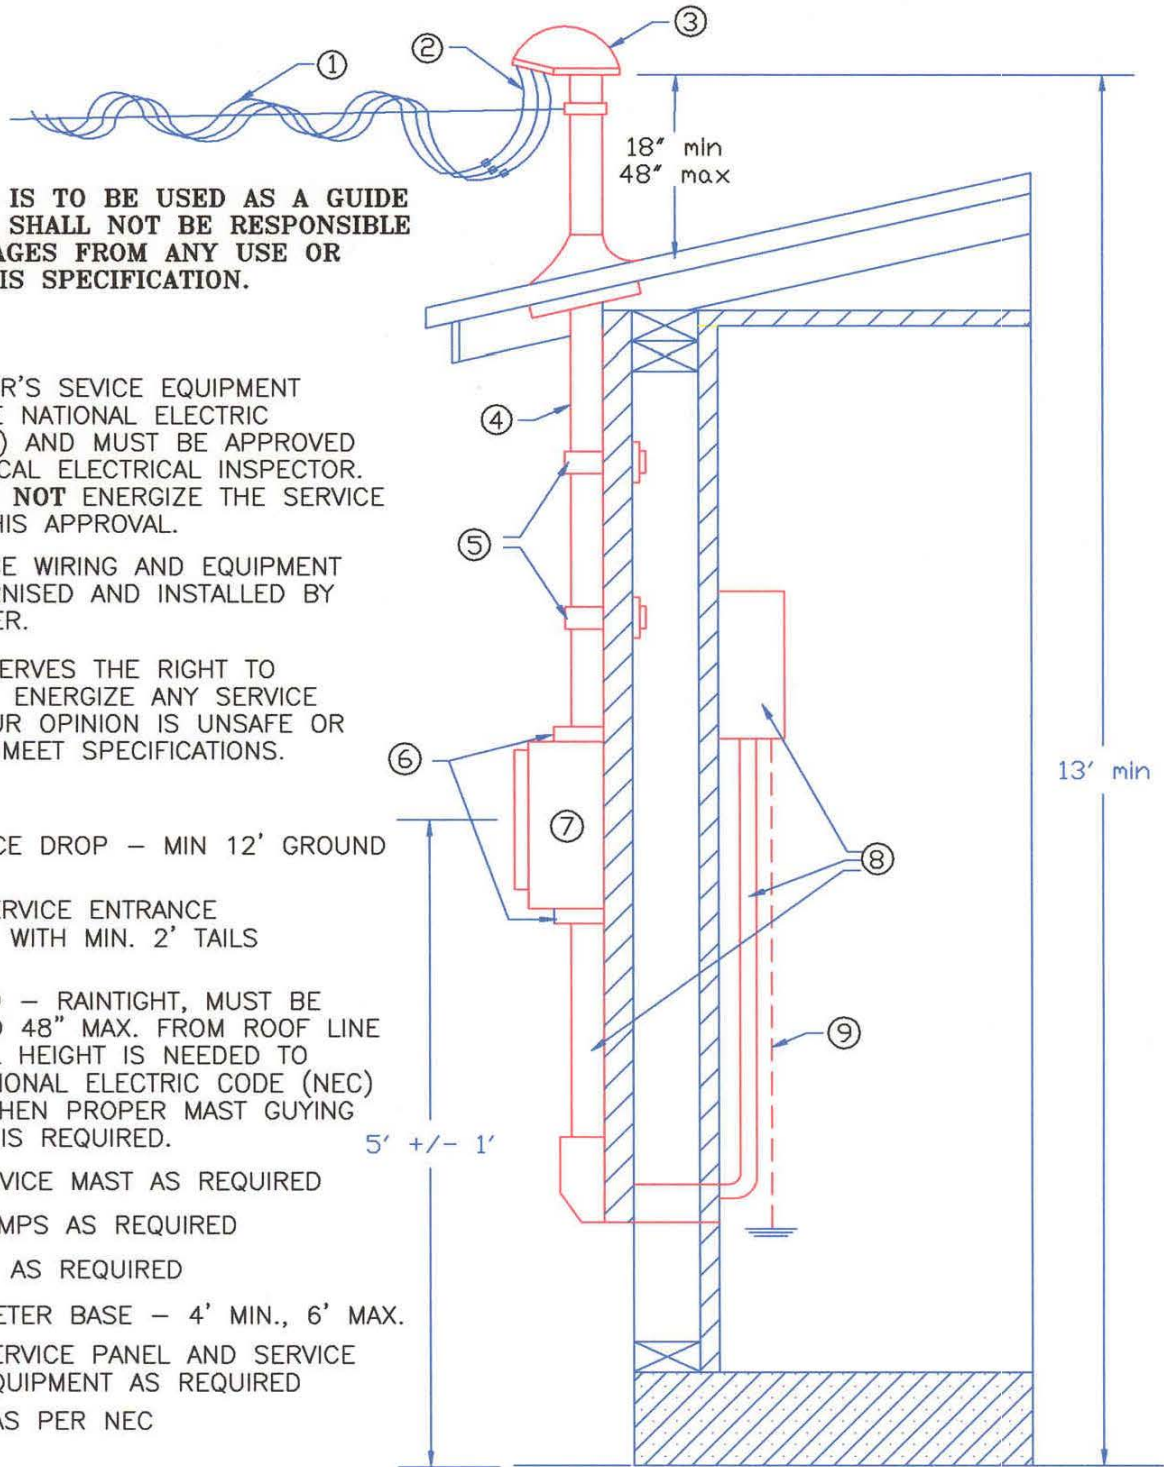

ACAD FILE
SPEC\HOUSIDE

DATE	DESCRIPTION
5/93	OVERHEAD SERVICE ENTRANCE
	MAST SERVICE ENTRANCE
	REVISED 11/25/03 AB

PRESQUE ISLE ELECTRIC & GAS CO-OP, INC.
 19831 M-68 HWY.
 P.O. BOX. 308
 ONAWAY, MI 49765-0308
 (989) 733-8515 (800)423-6634